
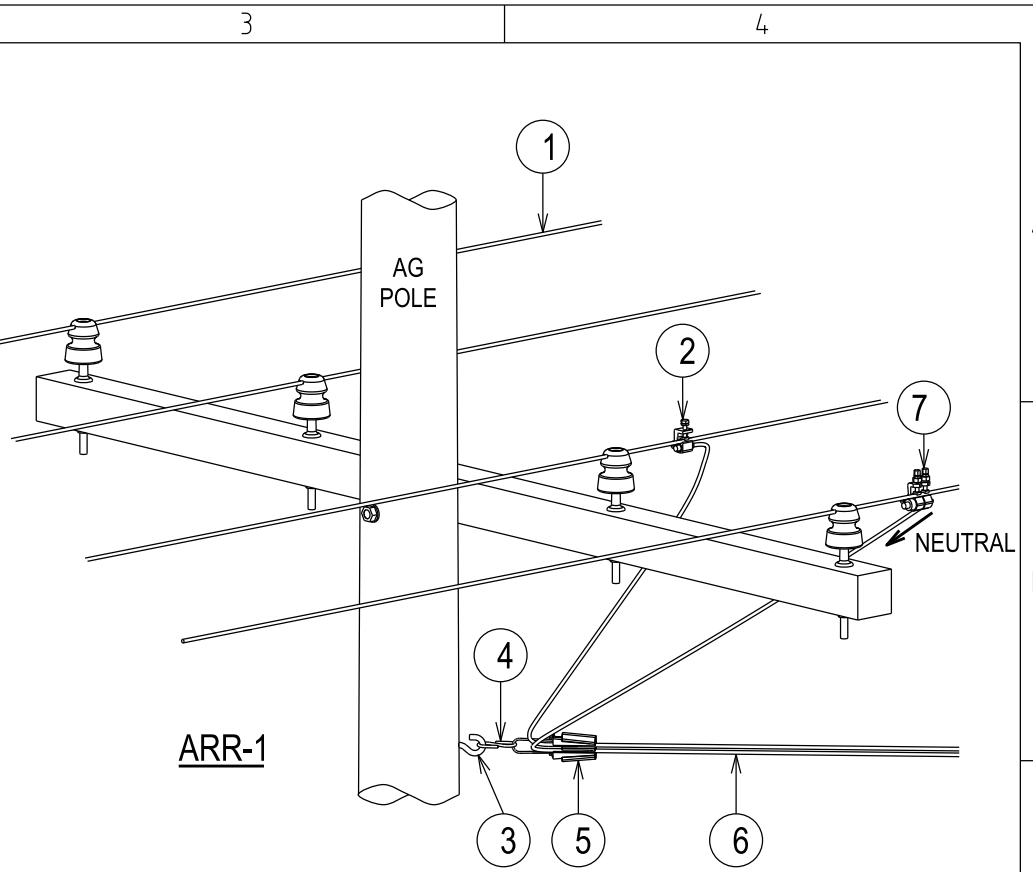


No.	DESCRIPTION	STOCK		QTY	
		AL	CU	ARR-1	ARR-2
1	CONDUCTOR - OVERHEAD	-	-	N/A	N/A
2	CONNECTOR - BARE MAINS/IPC	175051	H109694	1	1
3	HOOK - COACH SCREW M12x146	H75697	H75697	1	-
	HOOK - J SPIKE	1370	1370	-	1
4	LINK - WEAK CONNECTING	H81976	H81976	1	1
5	CLAMP - CABLE STRAIN 2-4 CORE 6-25mm <sup>2</sup>	H102491	H102491	1	1
6	SERVICE CABLE - 2x25mm <sup>2</sup> AL ABC, 2 CORE	H109298	H109298	A/R	A/R
7	CONNECTOR - SPLICE FOR NEUTRAL PHASE, 25-120 BARE Al	182904	-	1	1
	CONNECTOR - SPLICE FOR NEUTRAL PHASE, 7-100 BARE Cu	-	182905		

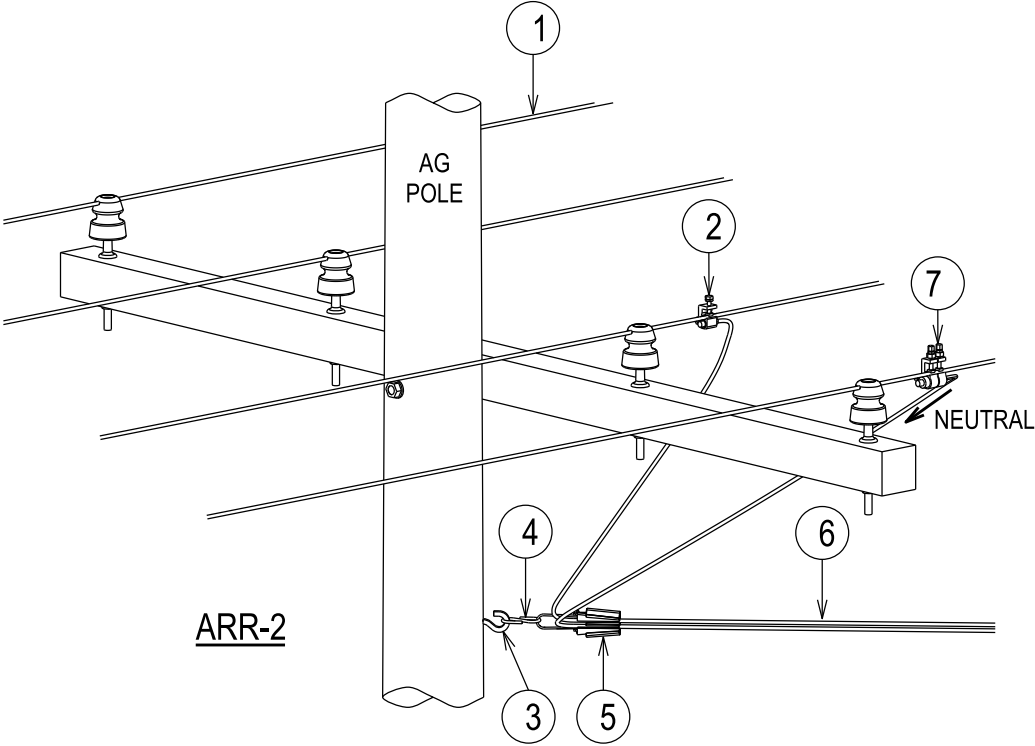

NOTE:  
IPC CONNECTOR ORIENTATION IS DIAGRAMMATIC ONLY, IT MAY BE INSTALLED IN ANY DIRECTION.

CAD DRAWING  
DO NOT MANUALLY AMEND  
AMENDMENTS

DWN: PATRICIA RIOS  
CHKD: HIRI EHAMPARAM

DATE: 09/04/2014  
NEUTRAL CONNECTION  
CHANGED, MATERIAL  
LIST AMENDED.

APPD: MATTHEW CUPPLES

5

NETWORK STANDARD

145 NEWCASTLE RD  
WALLSEND NSW 2287  
PHONE: 4951 9388  
FAX: 4591 9389

DESIGNED	ROBERT KNOWLES
DRAWN	PATRICIA RIOS
CHECKED	ROBERT KNOWLES
AUTHORISED	GREG SKINNER
DATE	02/07/04
SCALE	NTS
MAP REF.	
LGA	

STANDARD CONSTRUCTION  
100AMP OPEN WIRE MAINS  
SUPPORT FROM POLE - 1 PHASE

PROJECT No.	NET-STD
PROJTRAK No.	-
Sheet 01 of 1 Sheets	
A4	152478
	5