


No.	DESCRIPTION	STOCK		QTY
		AL	CU	
1	CONDUCTOR - BARE OVERHEAD			A/R
2	CONNECTOR - BARE MAINS IPC	175051	H109694	3
3	IN-SPAN CABLE - 4x25mm <sup>2</sup> AL XLPE ABC, 4 CORE	67959	67959	A/R
4	CLAMP - STRAIN CLAMP 4 CORE			1
5	EYENUT - M20 GALVANISED	H38853	H38853	1
6	NUT - M20 HEX GALVANISED	H39485	H39485	1
7	WASHER - SQUARE 50x50x6mm Ø22 HOLE, GALVANISED	H39265	H39265	1
8	CONNECTOR - SPLICE FOR NEUTRAL PHASE, BARE Al	182904	-	1
	CONNECTOR - SPLICE FOR NEUTRAL PHASE, BARE Cu	-	182905	

NOTE :  
THIS DRAWING IS TO BE READ  
IN CONJUNCTION WITH DRG : 192104.

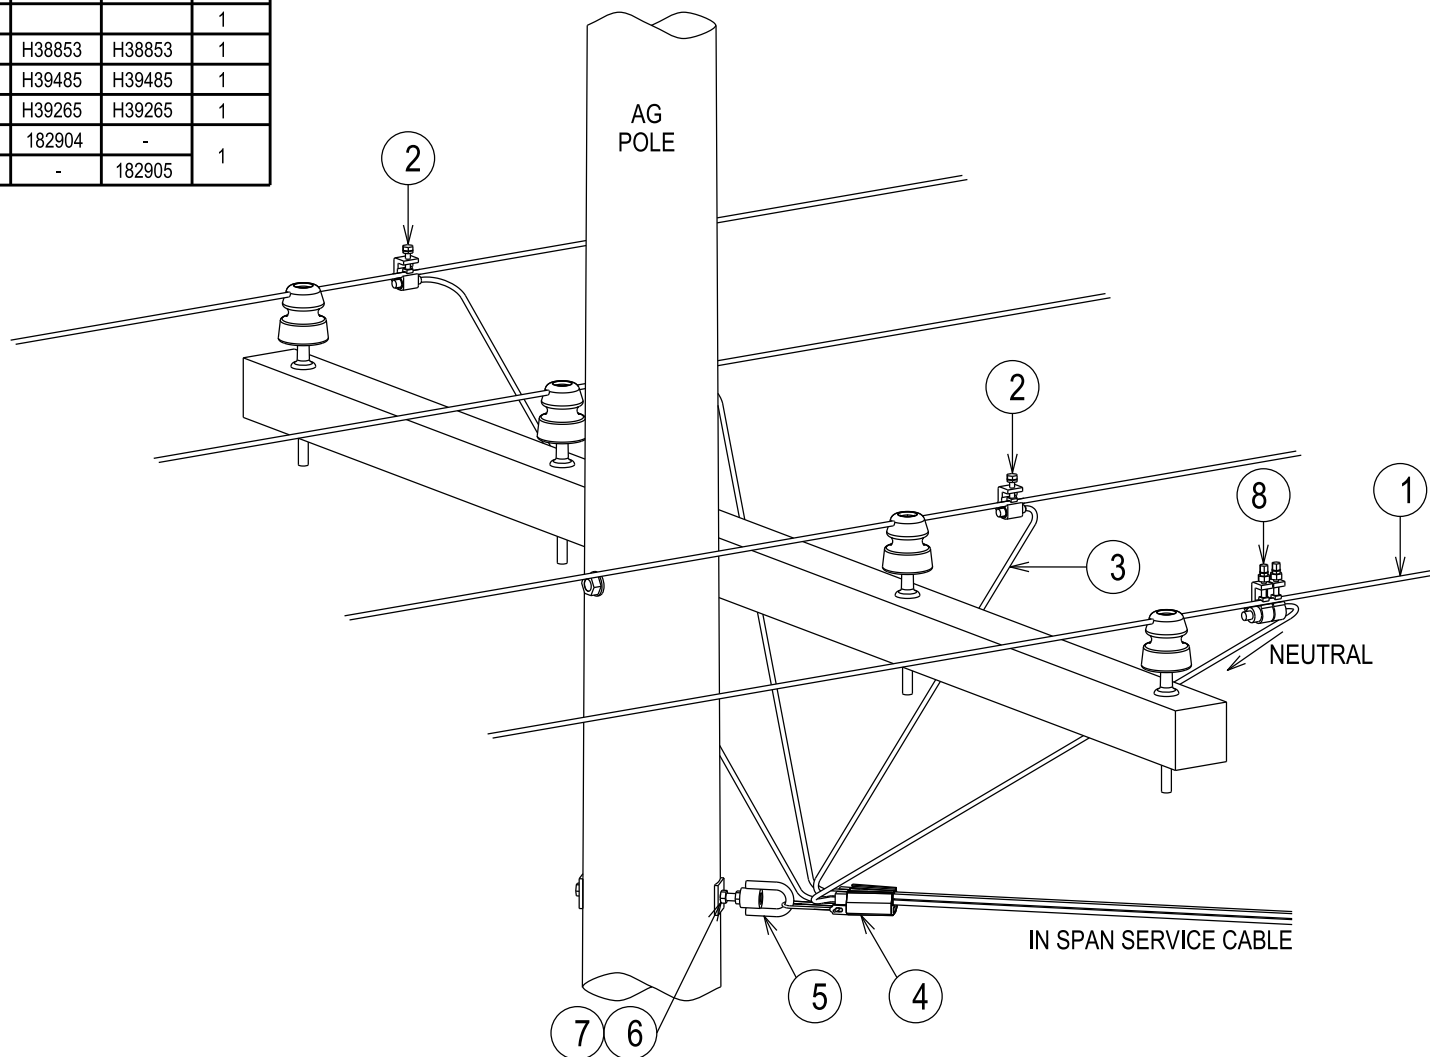

CAD DRAWING  
DO NOT MANUALLY AMEND  
AMENDMENTS  
DWN: PATRICIA RIOS  
CHKD: HIRI EHAMPARAM  
DATE: 17/04/2014  
NEUTRAL CONNECTION  
CHANGED, MATERIAL  
LIST AMENDED.  
4  
APPD: MATTHEW CUPPLES

NETWORK STANDARD  
**Ausgrid**  
145 NEWCASTLE RD  
WALLSEND NSW 2287  
PHONE: 4951 9388  
FAX: 4591 9389

DESIGNED	ROBERT KNOWLES
DRAWN	PATRICIA RIOS
CHECKED	ROBERT KNOWLES
AUTHORISED	GREG SKINNER
DATE	02/07/04
SCALE	NTS
MAP REF.	
LGA	

STANDARD CONSTRUCTION  
100AMP OPEN WIRE MAINS  
SUSPENDED SERVICE - IN SPAN

PROJECT No.	NET-STD
PROJTRAK No.	-
Sheet 01 of 1 Sheets	
A4	167461   4