


- NOTES:**
- THE FOLLOWING INFORMATION TO BE OBTAINED FROM THE LINE SCHEDULE;
 - POLE LENGTH
 - SPECIAL FOUNDATION REQUIREMENTS
 - VARIATIONS TO STANDARD POLE DEPTH
 - CONDUCTOR AND O.H.E.W. SIZES
 - STAY REQUIREMENTS
 - DEVIATION ANGLE
 - ASSESSED EARTHING REQUIREMENTS

POLE LENGTH m	'D' STANDARD DEPTH m	'U' m
18.5	2.45	11.325
20.0	2.60	12.675
21.5	2.75	14.025
23.0	2.90	15.375
24.0	3.00	16.275
26.0	3.20	18.075

	FROM DATUM	
	X	Y
O.H.E.W.	344	-158
	-344	-158
LOAD CENTRE O.H.E.W.	0	0
CONDUCTOR 'A'	1974	225
CONDUCTOR 'B'	-1984	-875
CONDUCTOR 'C'	1994	-1975
LOAD CENTRE CONDUCTOR	0	-1100

ITEM	DESCRIPTION	DRG.No.	STOCK CODE	QTY.
5	CONCRETE POLE FOOTING ARRANGEMENT	512331		1
4	CONCRETE POLE BUTT PLATE EARTHING ARRANGEMENT	520209		1
3	OVERHEAD EARTHWIRE TWIN SUSPENSION ARRANGEMENT	514188		1
2	OVERLOAD RELEASE HORIZONTAL LINE POST INSULATOR ARRANGEMENT -3	512206		3
1	POLE CONCRETE TYPE 6-200 C/TE AND 6-202 C/TE AND 6-230 C/TE	514185		1

DIMENSIONS ARE IN MILLIMETRES UNLESS STATED OTHERWISE DO NOT SCALE

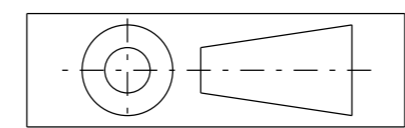

CAD DRAWING DO NOT MANUALLY AMEND AMENDMENTS A. INITIAL ISSUE DWN: P.S. CHKED: R.M. DWN: P.S. CHKED: P.A.S. B. DATE: 10.8.94 POLE LENGTH 'U' AND OFFSET TABLES AMENDED. AUTHD by: P. SUMNER DWN: GARY HUGHES CHKED: PHILLIP JONES 3. DATE: 11/11/2013 AUSGRID BORDER APPLIED. SUPERCEDED BY DRG: 520228. APPD by: GLENN FORD	ASSOCIATED DRAWINGS	
	1	2

NETWORK STANDARD
 145 NEWCASTLE RD WALLSEND, NSW 2287

SCALE	1:25	STANDARD CONSTRUCTION 132kV TRANSMISSION LINES STRUCTURE ASSEMBLY 6-202 C/TE			
DESIGNED					
DRAWN	P.S.				
CHECKED	P.A.S.				
APPROVED	I.NICHOLS				
DATE	11/08/92				
PROJECT NUMBER	STD	SIZE	DRAWING No	SHEET	AMD
PROJTRAK NUMBER		A2	514187	01	3