

**NOTES:**


1. THE FOLLOWING INFORMATION TO BE OBTAINED FROM THE LINE SCHEDULE:
  - a) POLE LENGTH, TYPE AND POLE CENTRES.
  - b) SPECIAL FOUNDATION REQUIREMENTS
  - c) VARIATIONS TO STANDARD POLE DEPTH
  - d) CONDUCTOR AND O.H.E.W. SIZES
  - e) STAY REQUIREMENTS
  - f) DEVIATION ANGLE
  - g) ASSESSED EARTHING REQUIREMENTS

POLE LENGTH	'D' STANDARD DEPTH	'U'	'R'	'A'
m	m	m	m	m
18.5	2.45	8.89	5.57	4.82
20.0	2.60	10.24	6.92	6.17
21.5	2.75	11.59	8.27	7.52
23.0	2.90	12.94	9.62	8.87
24.0	3.00	13.84	10.52	9.77
26.0	3.20	15.64	12.32	11.57

CONDUCTOR AND LOAD CENTRE OFFSETS		
	FROM DATUM	
	X	Y
O.H.E.W.	372	-53
LOAD CENTRE O.H.E.W.	0	0
CONDUCTOR 'A'	1696	190
CONDUCTOR 'B'	1716	-2010
CONDUCTOR 'C'	1736	-4210
LOAD CENTRE CONDUCTOR	0	-2200

5	CONCRETE POLE FOOTING ARRANGEMENT	512331		2
4	CONCRETE MULTIPLE POLE WITH BUTT PLATE, EARTHING ARRANGEMENT	520210		1
3	OVERHEAD LINE INTER POLE STAYING AND BONDING ARRANGEMENT - A	520247		1
2	O/L HORIZONTAL LINE POST INSULATOR MOUNTING AND BONDING ARR-3a	514161		6
1	POLE CONCRETE TYPE 6-260 C/E	520224		2
ITEM	DESCRIPTION	DRG.No.	STOCK CODE	QTY.

DIMENSIONS ARE IN MILLIMETRES UNLESS STATED OTHERWISE DO NOT SCALE

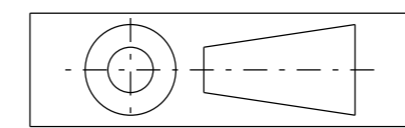

CAD DRAWING DO NOT MANUALLY AMEND AMENDMENTS A. DWN: P.S. CHKED: P.A.S. B. DWN: P.S. CHKED: P.A.S. DATE: 20-6-94 STAY RELOCATED TO 450 mm. FROM POLE HEAD. AUTHD BY: P. SAMNER DWN: PATRICIA RIOS CHKED: PHILIP JONES DATE: 06/12/2017 AUSGRID BORDER APPLIED. SUPERCEDED BY DRG: 520229.		APPD BY: DOMINIC SHIELDS	
ASSOCIATED DRAWINGS			

NETWORK STANDARD  
 145 NEWCASTLE RD WALLSEND,  
 NSW 2287

SCALE	1:25
DESIGNED	
DRAWN	P.S.
CHECKED	P.A.S.
APPROVED	I.NICHOLS
DATE	05/05/94
PROJECT NUMBER	STD
PROJTRAK NUMBER	

STANDARD CONSTRUCTION  
 132kV TRANSMISSION LINES  
 STRUCTURE ASSEMBLY  
 6-260 C/E

SIZE	DRAWING No	SHEET	AMD
A2	520223	01	3