


**BOTTOM VIEW**

**SIDE VIEW**

**TOP VIEW**

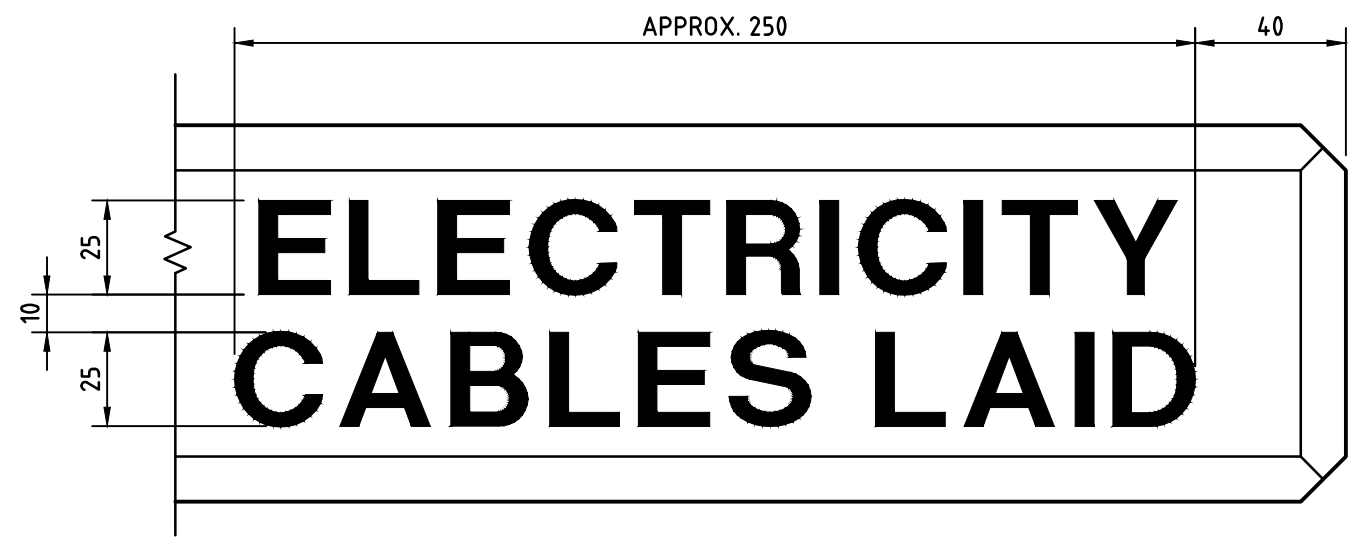

**LETTERING DETAIL**  
LETTERING TO BE 6mm DEEP.  
SEE NOTES 2 & 3.

**NOTES**

1. CONCRETE FOR POST TO HAVE 40MPa MIN. COMPRESSION STRENGTH @ 28 DAYS. MAX. AGGREGATE SIZE TO BE 20mm. MIN. COVER 45mm. POST TO BE REINFORCED WITH N12 DEFORMED BAR.
2. LETTERING TO BE IMPRINTED 6mm DEEP & TO BE CLEARLY DEFINED & LEGIBLE.
3. INSCRIPTION TO BE ON ONE FACE ONLY.
4. THE EXPOSED PORTION OF THE POST SHALL BE GIVEN TWO COATS OF 'GOLDEN YELLOW' PLASTIC PAINT TO AS2700S - 1996 COLOUR CODE Y14.

CAD DRAWING DO NOT MANUALLY AMEND AMENDMENTS	2. REDRAWN ON CAD. LETTERING ALTERED TO ELECTRICITY. PAINT COLOUR & NOTES ALTERED TO SUIT NEW STANDARDS.
	R.GLANVILLE 14.03.94 PROD No M160
	3. CONCRETE & REINFORCEMENT UPDATED TO CURRENT STANDARDS. ELECTRICITY SPELT CORRECTLY.
	C.SAWDY 15.03.2011 APPR'D P.HUDSON
4. NEW AUSGRID BORDER AND LOGO ADDED.	
R.LAALAA 14.10.2013 APPROVED T.LAMPARD	


**NETWORK STANDARD**  
**Ausgrid**  
 DESIGN AND ENGINEERING BRANCH  
 24 CAMPBELL ST SYDNEY NSW 2000

SCALE	-
DESIGNED	RVG
DRAWN	RVG
CHECKED	CJS
APPROVED	R.MEE
DATE	MARCH 94
PROJECT NUMBER	500338
PROJTRAK NUMBER	-

<b>CABLE ROUTES</b>			
<b>CONCRETE MARKER POST</b>			
<b>DETAILS</b>			
SIZE	DRAWING No	SHEET	AMD
<b>A3</b>	<b>42087</b>	<b>1</b>	<b>4</b>