


NS 171 DETAIL - APPENDIX B

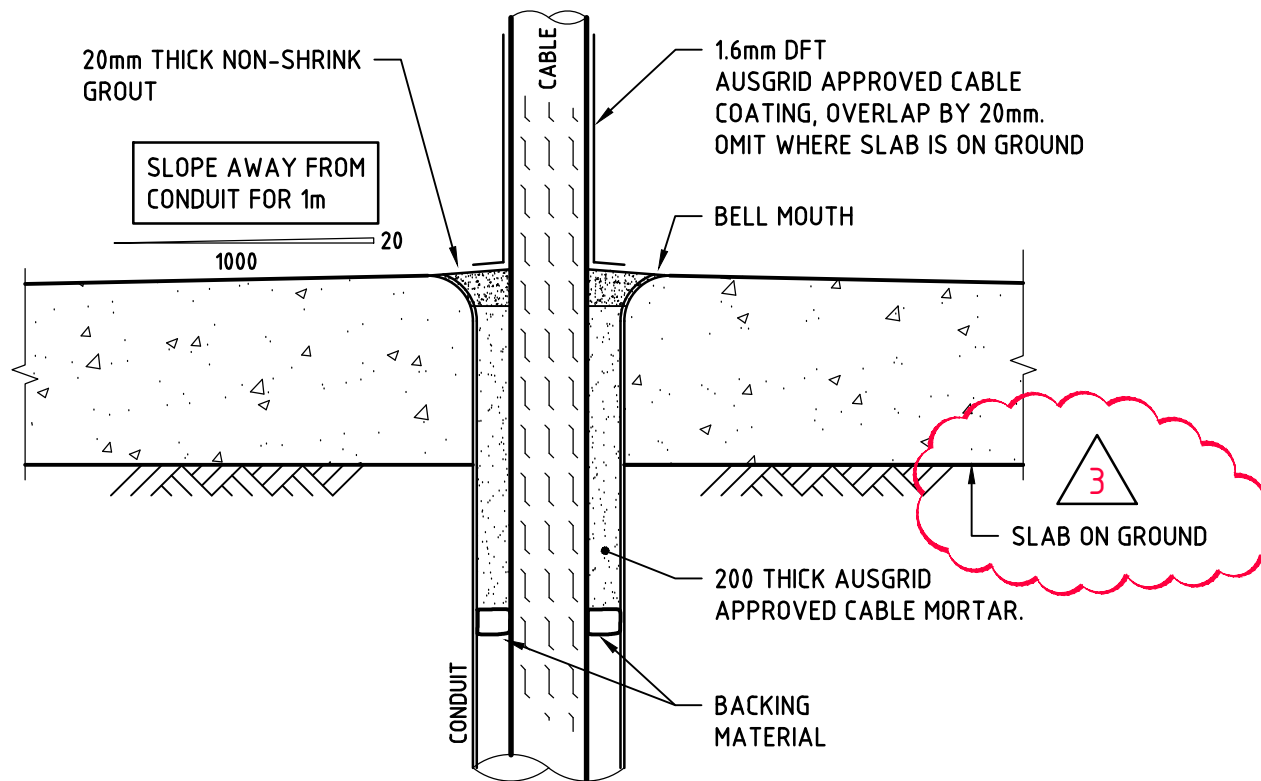

SECTION

NOTE:
FOR HV/LV POWER CABLES ONLY (not for secondaries)

LIMITATIONS OF USE:

- DO NOT USE IF $(D^2 \text{ CABLE} / D^2 \text{ CONDUIT})$ IS GREATER THAN 0.6 (60%) WHERE D = DIAMETER. WHERE THIS OCCURS REFER TO DESIGN BRANCH SYDNEY

CAD DRAWING DO NOT MANUALLY AMEND AMENDMENTS	0. ISSUED FOR CONSTRUCTION JAN 12.08.08	1. NEW AUSGRID BORDER & LOGO ADDED. RLAALAA 17/10/2013 APPROVED TLAMPARD	2 NOTE ADDED DES: J. WOODBRIDGE DWN: A. SPITERI CHKD: K. GALLEN DATE: 26/07/2016	APP'D by: K. GALLEN	3 NOTE (SLAB ON GROUND) ADDED. DES: J. WOODBRIDGE DWN: B. BARTLEY CHKD: K. GALLEN DATE: 09-05-17	APP'D by: K. GALLEN
--	--	--	---	---------------------	---	---------------------



SCALE	1:5
DESIGNED	
DRAWN	JA
CHECKED	JW
APPROVED	M-DESIGN JW
DATE	12/08/2008

MORTAR SEAL
FOR OUTDOOR FLOOR
PENETRATIONS
SLAB ON GROUND

PROJECT No.	ES 102-9
PRJTRK No.	
Sheet	1
A4	190509
	3