

ENCLOSURE NOT SHOWN

See Detail A

| SUMMARY OF MASS:- | | |
|----------------------|------|-------|
| TRANSFORMER OIL VOL. | 544 | Ltrs. |
| TRANSFORMER TOTAL | 1886 | kg. |
| ENCLOSURE | 100 | kg. |
| CHANNEL BASE | 100 | kg. |
| L.V. SWITCHGEAR | 250 | kg. |
| H.V. SWITCHGEAR | 350 | kg. |
| KIOSK TOTAL | 2686 | kg. |
| CONCRETE BASE | 2000 | kg. |
| TOTAL MASS | 4686 | kg. |

PAINT COLOUR
 TRANSFORMER :- N42 STORM GREY
 ENCLOSURE :- RAINFOREST GREEN


WIRED LIGHT PLUG

ENCLOSURE & CONCRETE BASE NOT SHOWN

| | | | |
|---|----|--|--------------------|
| 1 | 38 | VALVE BALL 32MM BORE LOCKABLE | VAL5081 |
| 1 | 37 | T/C, ROTARY 33KV,9POS,60A, GAMEX | TCR060A9P3PH |
| 1 | 36 | BATTERY BOX | SCHNEIDER-BATTBOX |
| 1 | 35 | EARTH BAR LINK | S1B2305101 |
| 1 | 34 | EARTH BAR LINK | S1B2305001 |
| 1 | 33 | MAIN EARTH BAR | S1B2304901 |
| 1 | 32 | FINAL ASSEMBLY OF CHANNEL BASE | S1B2068301 |
| 1 | 31 | ENCLOSURE WALL | S1A9972901 |
| 1 | 30 | DMA RM6 11KV 25KA/3S MOT P.SW | RM62N61XIQIEAMT101 |
| 1 | 29 | POWERSENSE BOX | POWERSENSE |
| 1 | 28 | PLUG,GAL,FLG,DN32,M | PLG1362 |
| 1 | 27 | HD SP BACK ENTRY PLUG 10A WHI | PDL905WH |
| 1 | 26 | LABEL - HIGH VOLTAGE | LAB5279 |
| 1 | 25 | ENCL ASSY FIBREGLASS FOR L RANGE | KEAKLENC-BOL-V4 |
| 1 | 24 | OIL PRESENCE INDICATOR | IND5026 |
| 1 | 23 | SAIF LV BOARD KL #ZE102 LB 4/4/4/4 | EZE102 |
| 1 | 22 | AUSGRID KL GENERIC KIOSK ASSLY - 400KVA | EAV4555701 |
| 1 | 21 | CAP ALUM 130DIA HERM / SEAL | CAPAL130 |
| 3 | 20 | SURGE ARRESTOR AK POWER SOLUTIONS 5KA | BSH5122 |
| 4 | 19 | BSH ASSY#72 3.3KV 700A | BSH390901 |
| 3 | 18 | BUSH WELL 33KV, 200 A, TO SUIT ELAST. K1501-A1 | BSH2023 |
| 3 | 17 | INSERT 22KV,200A, ELASTIMOLD K1501-A1 | BSH1664 |
| 1 | 16 | PRESSURE SWITCH COVER | BBV1737001_MIG26 |
| 1 | 15 | UNISTRUT FOR HV CABLE SUPPORT | BAU1560201 |
| 2 | 14 | WARNING LABEL - RM6 | BAU1559301 |
| 1 | 13 | BAFFLE BOTTOM HV | BAU1521901 |
| 1 | 12 | RM6 RAISING PLINTH ASSLY - LH | BAU1513301 |
| 1 | 11 | RM6 RAISING PLINTH ASSLY - RH | BAU1513201 |
| 1 | 10 | TERMINAL BOX - ASSLY | BAU1202701 |
| 1 | 9 | PRESSURE SWITCH LABEL | AAV8357101_MIG26 |
| 1 | 8 | PRESSURE SWITCH DISPLAY | AAV7454701_MIG26 |
| 1 | 7 | RM6 SWITCHGEAR EXTENSION HANDLE | A048069 |
| 1 | 6 | CONCRETE BASE | 6675359C |
| 1 | 5 | TANK FINISH AUSGRID KL 400KVA | 5505153401 |
| 1 | 4 | NAME PLATE 400KVA 11/0.433KV Dyn1 +3 to -5 in 1.5% STEPS | 4943264701 |
| 1 | 3 | MASS PLATE KL 400 KVA | 4942191501 |
| 1 | 2 | TRANSFORMER PLINTH | 6675387 |
| 2 | 1 | SIGN DANGER-HIGH VOLT KEEP OUT | 4942122-9 |

| REFERENCE DRAWING LIST | |
|----------------------------|------------|
| DESCRIPTION | DRAWING # |
| RM6 GA WITH WIRING DIAGRAM | S1B2134500 |
| POWERSENSE | S1B2135000 |
| | |
| | |

| REV | DATE | DETAILS OF REVISION | DRAWN | CHKD | APPR |
|-----|----------|--|-------|------|------|
| 05 | 20/10/15 | ECN 1440: Issued for construction. LV board view updated. Base 6675359C was 66753044 | MJ | AS | TAS |
| 04 | 05/09/15 | ECN 1427: LV copper flexibles modified to 2 point connection on Bushing palm | MJ | AS | TAS |
| 03 | 08-01-15 | DETAIL "B" ADDED, REFER SHEET 2/2. UPDATED DRG. ON CUSTOMER FEEDBACK. ECN# 1283. | DS | MJ | TAS |
| 02 | 12-11-14 | MASS PLATE ADDED AT TX. LEVEL. | DS | MJ | TAS |
| 01 | 23-10-13 | DRAIN VALVE SIZE CHANGED TO 32MM | AA | SH | GA |
| 00 | 04-10-13 | RELEASED FOR MANUFACTURING | AA | SH | GA |

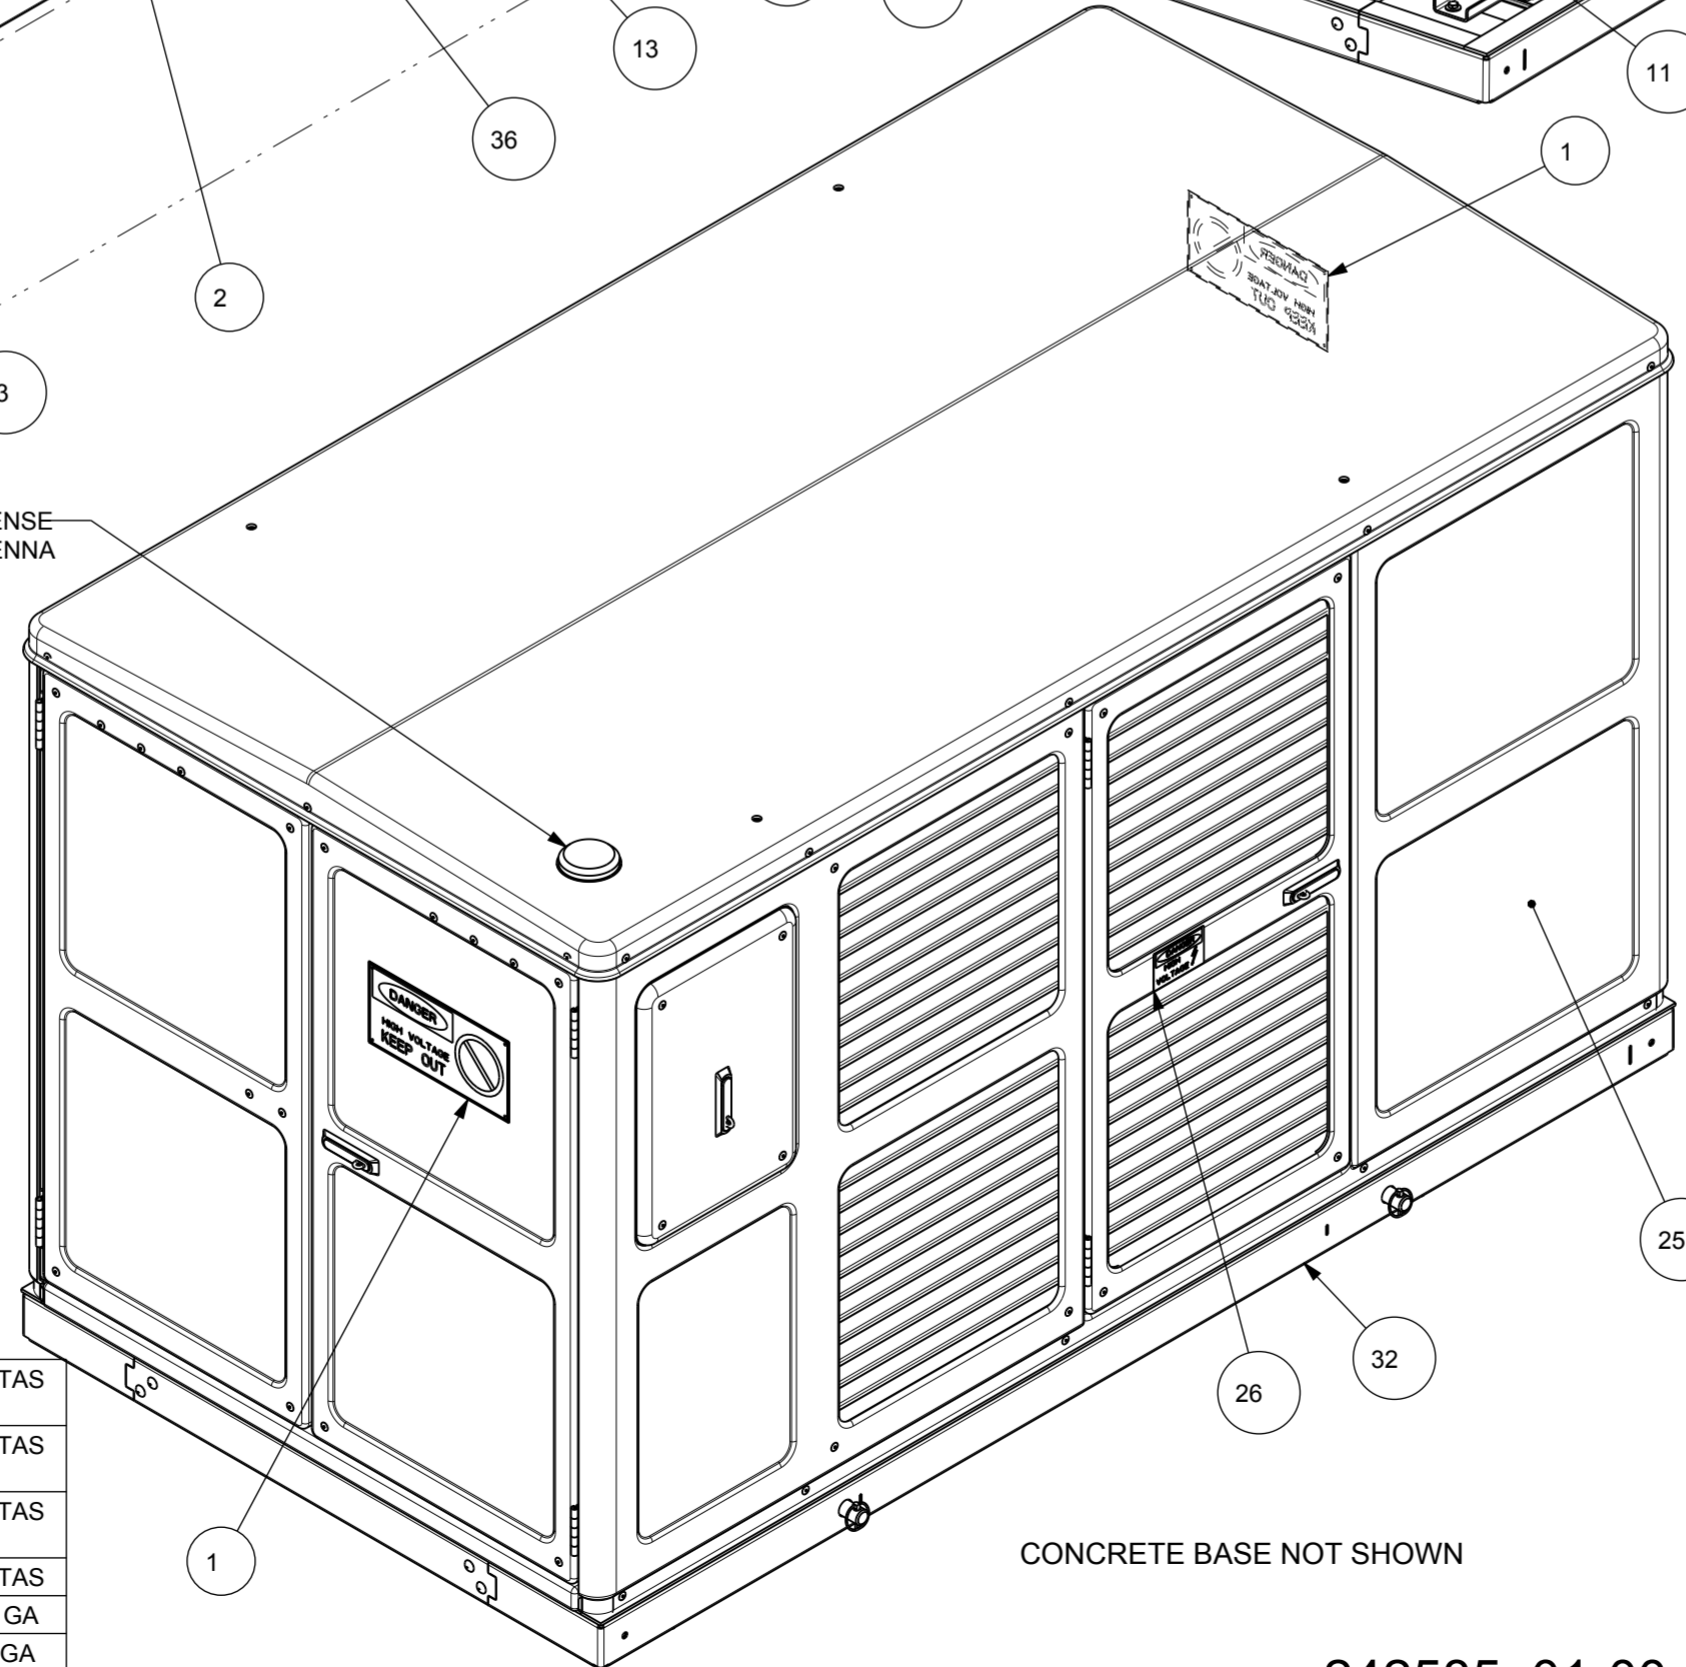

Scale: 0.075
 Tolerancing Standard: ISO 2768cL
 ISO 8015
 Units of measure: millimeter

Schneider Electric

AUSGRID KL GENERIC GA 400KVA
 CONTRACT # AG2869/11, ITEM # 5, 6 & 7

Number: **EAV4555602**
 Revision: **05**
 Sheet: **1/2**

The information is highly confidential and is the exclusive property of Schneider Electric Group. Copyright reserved. This drawing must not be used for any purpose other than that expressly permitted in writing by the owners and must not be disclosed or reproduced in any way without permission from the owners in writing. This drawing must be returned to the owners when the purpose has ceased.

242585 01r00